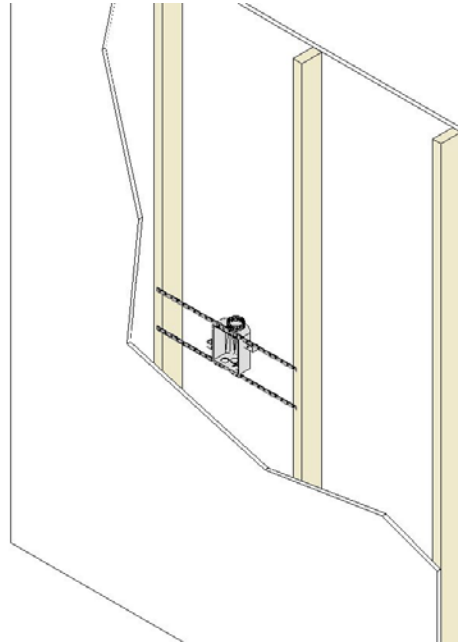

IPS Corporation
Design No. IPS/FI 120-02
Firestop Systems
FR 1200 Series PVC Fire Rated Box
ASTM E814 (2013a)
Rating: 2 Hour (F), 101 Minutes (T); 1 Hour (F), 41 Minutes (T)
CAN/ULC S115 (2011)
Rating: 2 Hour (FH), 101 Minutes (T); 1 Hour (FH), 41 Minutes (T)



- 1. FIRE RATED WALL ASSEMBLY:** Gypsum board, steel or wood stud wall, with min. 3-1/2 in. cavity depth, having a 1 or 2 hour fire rating. The 'F' rating of the assembly with the fire rated box (Item 4) will equal that of the wall assembly.
- 2. PIPE MATERIAL (Not Shown):** Nominal 2 in. or larger metallic, ABS, or PVC DWV piping. Metallic or plastic water supply piping.
- 3. SUPPORT BARS (Optional):** Install support bars into the top and bottom tabs of the Fire Rated Box (Item 4) and secure assembly to the studs prior to installation of gypsum board using approved fasteners and methods.
- 4. CERTIFIED MANUFACTURER:** IPS Corporation

CERTIFIED PRODUCT: FR 1200 Fire Rated PVC Boxes

Fire Resistant Boxes are made from PVC with a listed intumescent pad applied to the back exterior side of the box. The Fire Rated Box may be installed either to the stud or into optional support bars (Item 3) using approved fasteners and methods.

- Box Only – Model Numbers 83068, 83086, 83087
- Ice Box – Model Numbers 83069 to 83084 and 83338 to 83377
- Gas Box – Model Numbers 83347 to 83349
- Air Admittance Valve Box – Model Number 83085
- Washer Box – Model Numbers 83036 to 83051 and 83323 to 83337