



SLEEVE ASSEMBLY FOR FLUSH & RECESSED 3" STACK FITTING


3" PROSET FIRE RATED PENETRATIONS THROUGH CONCRETE FLOORS

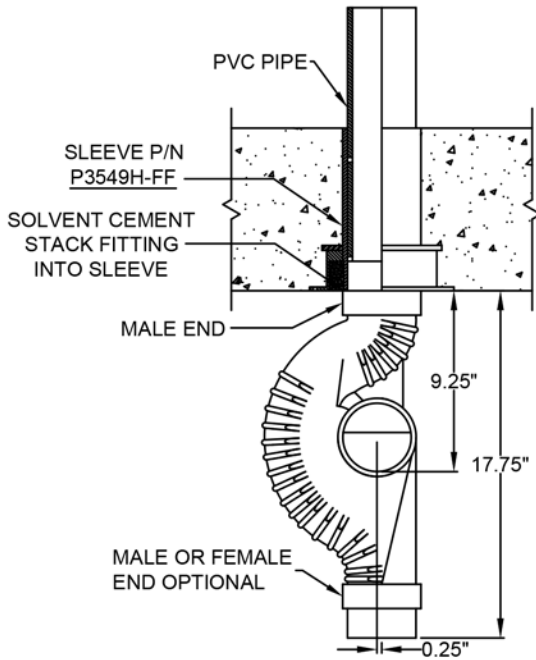


P3549H-FF
3" Stack Top is Male

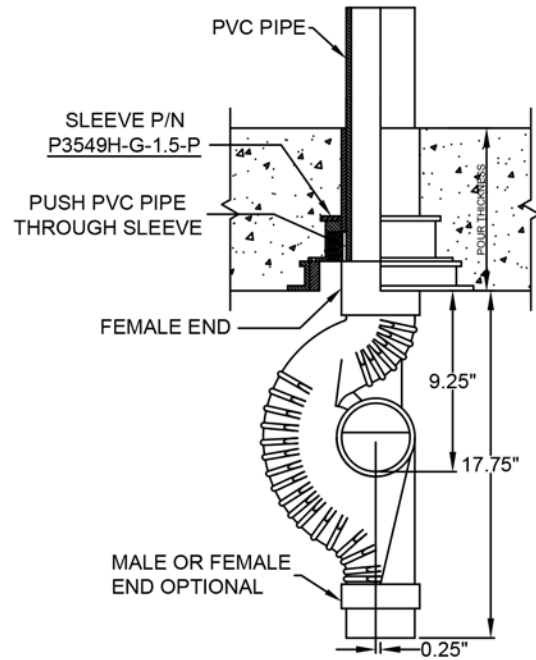

P3549H-G-1.5-P
3" Stack Top is Female

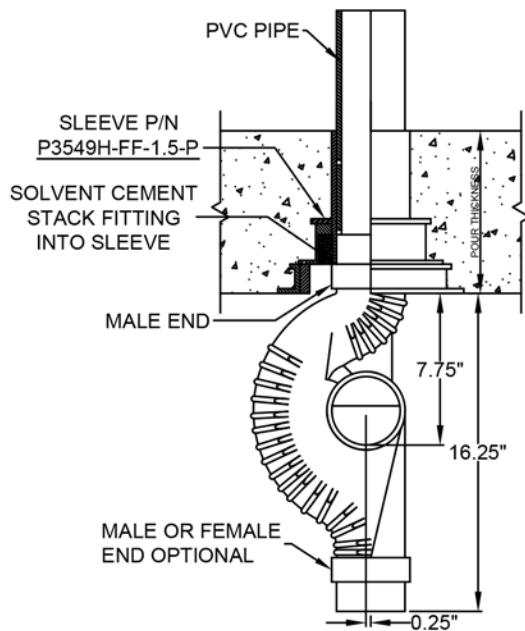

P3549H-FF-1.5-P
3" Stack Top is Male

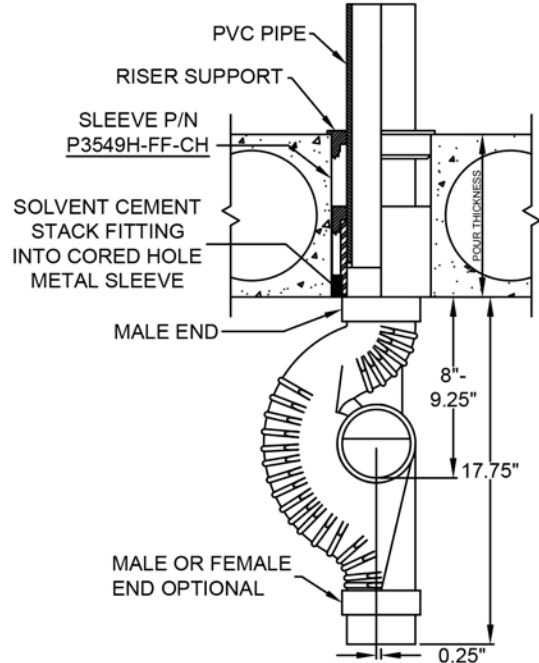

P3549H-FF-CH
3" Stack Top is Male



W.H. Directory Reference 00 Edition
Firestop Device
W.H. Design No. PS/PHV 180-03
F Rating 3 Hrs.



DATE :
5-31-21
DRG . NO .
C-9049-3FFRp