



# RECESSED SLEEVE ASSEMBLY FOR 3" STACK FITTING


3" PROSET FIRE RATED PENETRATIONS THROUGH CONCRETE FLOORS

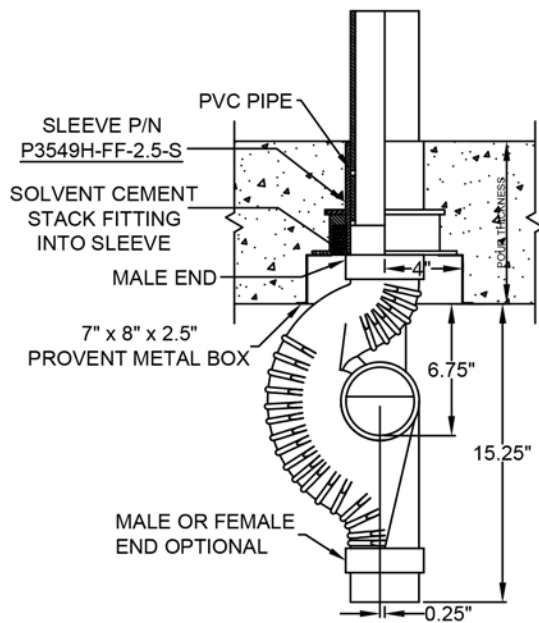


P3549H-FF-2.5-S  
3" Stack Top is Male

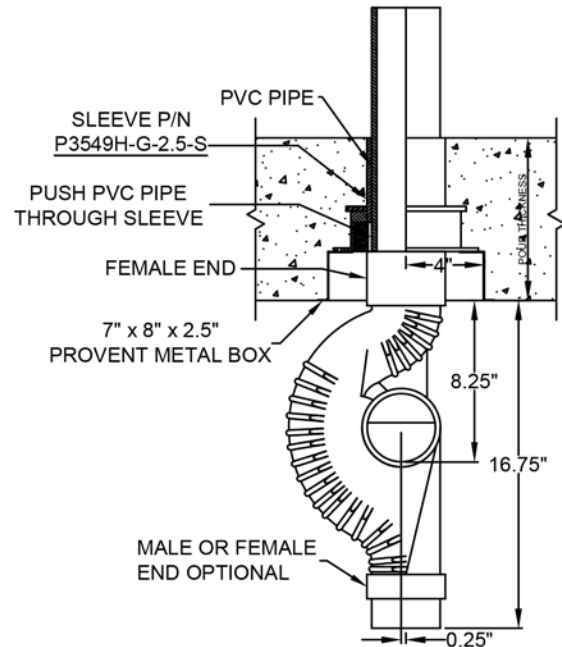

P3549H-G-2.5-S  
3" Stack Top is Female

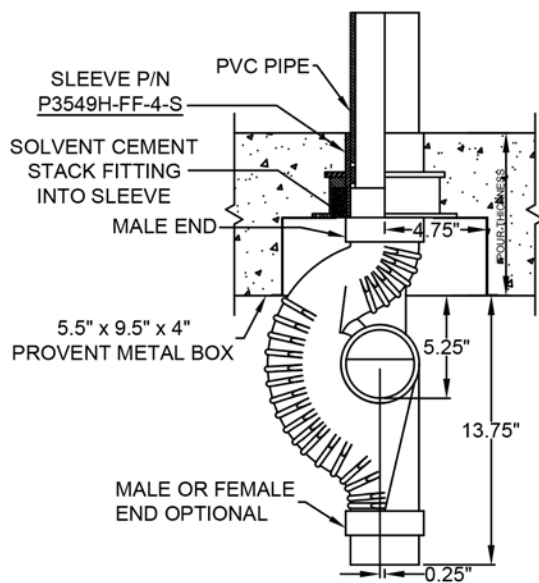

P3549H-FF-4-S  
3" Stack Top is Male

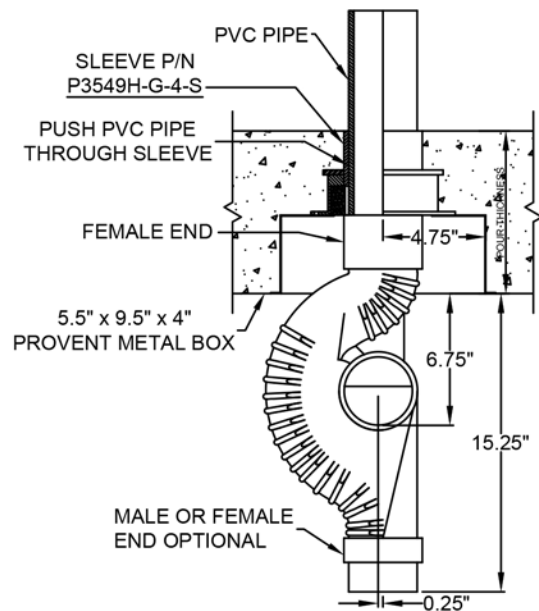

P3549H-G-4-S  
3" Stack Top is Female



W.H. Directory Reference 00 Edition  
Firestop Device  
W.H. Design No. PS/PHV 180-03  
F Rating 3 Hrs.

**IPS**  
CORPORATION

DATE :

5-31-21

DRG . NO .  
C-9049-3R